


DUCTCAP®


Submittal for Ductcap® Cover

A temporary end cap, made of polypropylene and elastic, for use in protecting air handling systems.

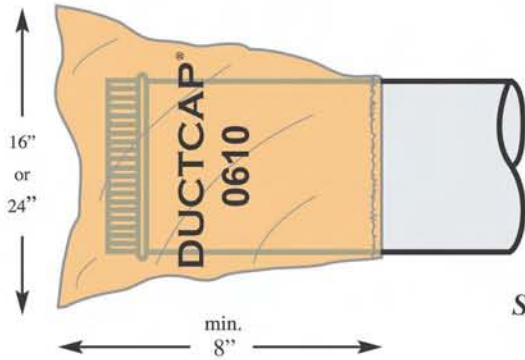

#0610 - 16" x 14" DUCTCAP fits 6" through 9" round or 16-31 Linear Inches
#1014 - 24" x 14" DUCTCAP fits 10" through 14" round or 32-47 Linear Inches

Styles 0610 and 1014 are manufactured from .002 mil thickness orange polypropylene plastic with a 1/4" elastic band.

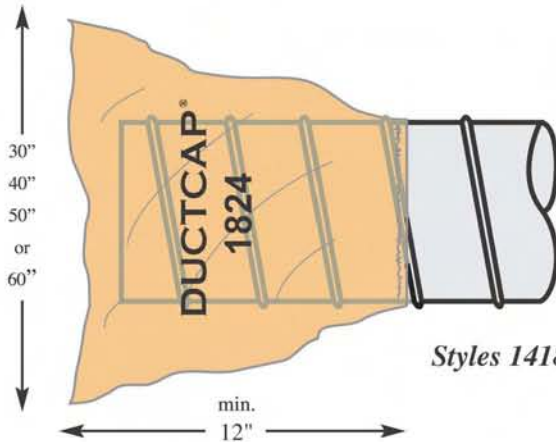

#1418 - 30" x 18" DUCTCAP fits 14" through 18" round or 48-59 Linear Inches
#1824 - 40" x 18" DUCTCAP fits 18" through 24" round or 60-79 Linear Inches
#2430 - 50" x 18" DUCTCAP fits 24" through 30" round or 80-99 Linear Inches
#3038 - 60" x 18" DUCTCAP fits 30" through 38" round or 100-119 Linear Inches

Styles 1418, 1824, 2430 and 3038 are manufactured from .0025 mil thickness orange polypropylene plastic with a 3/8" elastic band.



DUCTCAP PRODUCTS INC.

Ductcap is a registered trademark of Ductcap Products, Inc. All rights reserved.

PATENT #: US 6.874.541 B2

SECTION 15705

MINI-DUCT HVAC SYSTEM

PART 1 GENERAL

1.1 SUMMARY

- A. Provide a temporary Polyethylene film seal end cap for all high and low velocity HVAC mini-duct openings to prevent contamination of the HVAC ductwork interior prior to start-up of the HVAC system.
- B. On duct sizes 6" in the diameter to 14" in diameter or 16-47 linear inches for square or rectangular ducts, the Polyethylene film seal shall be capable of extending at least 8" beyond the opening of the duct and shall be attached to the duct by means of an elastic band sewn around the circumference of the film seal. The Polyethylene film shall be a minimum of 2 mil (.002") thickness and the elastic band shall be a minimum of 1/4" thick.
- C. On duct sizes 14" in diameter to 38" in diameter or 48-119 linear inches for square or rectangular ducts, the Polyethylene film seal shall be capable of extending at least 12" beyond the opening of the duct and shall be attached to the duct by means of an elastic band sewn around the circumference of the seal. The Polyethylene film shall be a minimum of 2.5 mil (.0025") thickness and the elastic band shall be a minimum of 3/8" thick.

1.2 SUBMITTALS

- A. Polyethylene Material Specifications
- B. Product Data: Manufacturer's published literature on the actual components to be installed.
- C. Shop Drawings: Show duct layouts and locations of air outlets and returns inlets, details of installation of temporary film seals and sizes of openings.

1.3 MANUFACTURERS

- A. Acceptable Manufacturer: Ductcap Products Inc.,

1.4 INSTALLATION

- A. Install in accordance with applicable local codes and manufacturer's instructions.